


Sl.No.	DESCRIPTIONS
1.	Base channel 75 x 40
2.	Bearing
3.	Insulator 11 KV
4.	Fixed contact 70 x 35 x 6
5.	Moving Contact blade 220 x 35 x 6 /
6.	Fixed Terminal connector 65 x 35 x 6
7.	Moveable Terminal Connector 65 x 35 x 6
8.	Arcing horn
9.	Phase Operating lever
10.	Moving connector.
11.	Fixed connector.
12.	Copper braided tape. 320 MM Length
13.	Earth terminal.
14.	Moveable Contact supported Angle 45 x 45 x 6
15.	Name plate.

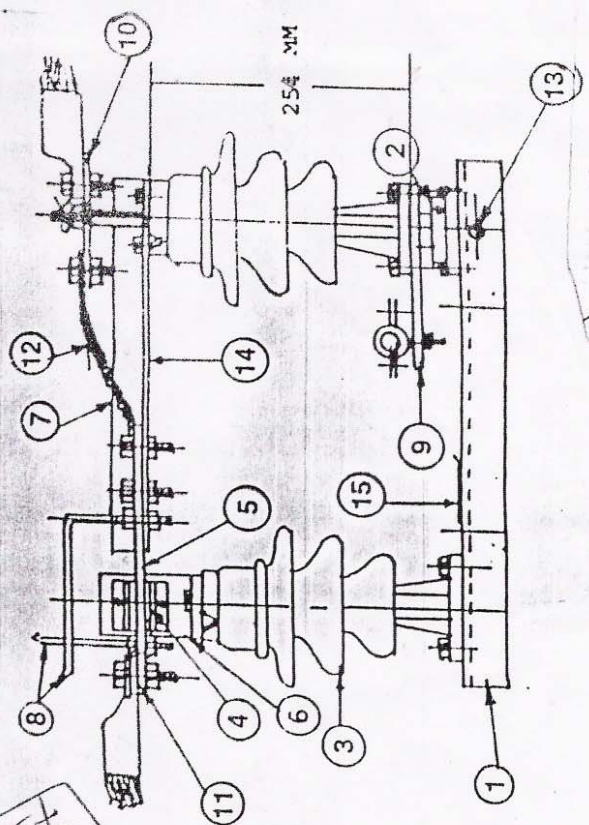

**NOTES:**

1. All Dimensions are in mm.
2. Tolerance  $\pm 5\%$
3. All ferrous parts shall be hot-dip galvanised.
4. All non-ferrous parts shall be silver plated.
5. Suitable spring and flat washer shall be provided with each nut, bolt wherever necessary.

Southern Electricity Supply Co. of Orissa Ltd.,  
Berhampur

All dimensions are in MM

11 KV A.B Switch (H- Type) 200 Amps, 2 Pole

Asst. Engineer (Pro) Southco, Berhampur  
 General Manager (Pro) Southco, Berhampur